
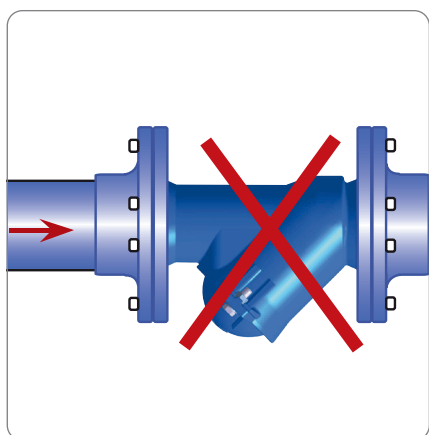
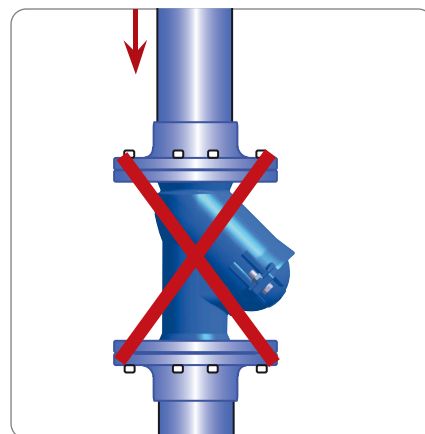
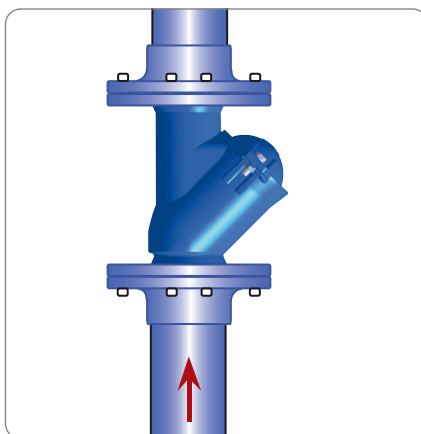



AVK BALL CHECK VALVE

SERIES 53

Mounting instruction / Montagevejledning
Einbauanleitung / Instruction de montage

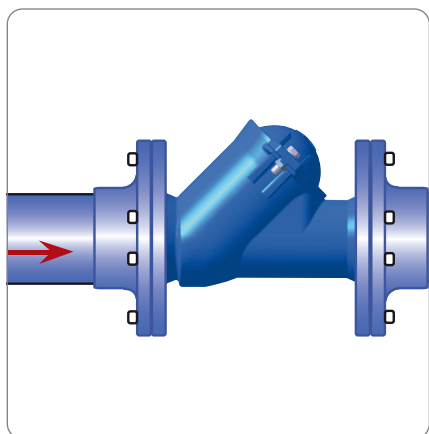

Valve fully open at approx. 0.5 m/s

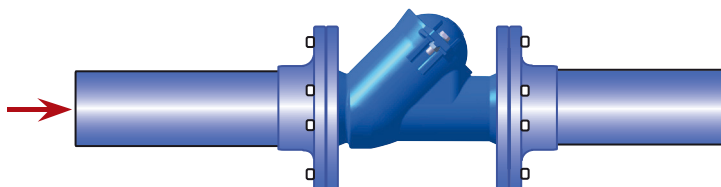

Closed valve at min. 0,2 bar in both positions vertical and horizontal

Mounting distance downstream pumps and elbows min. 5 x DN.